
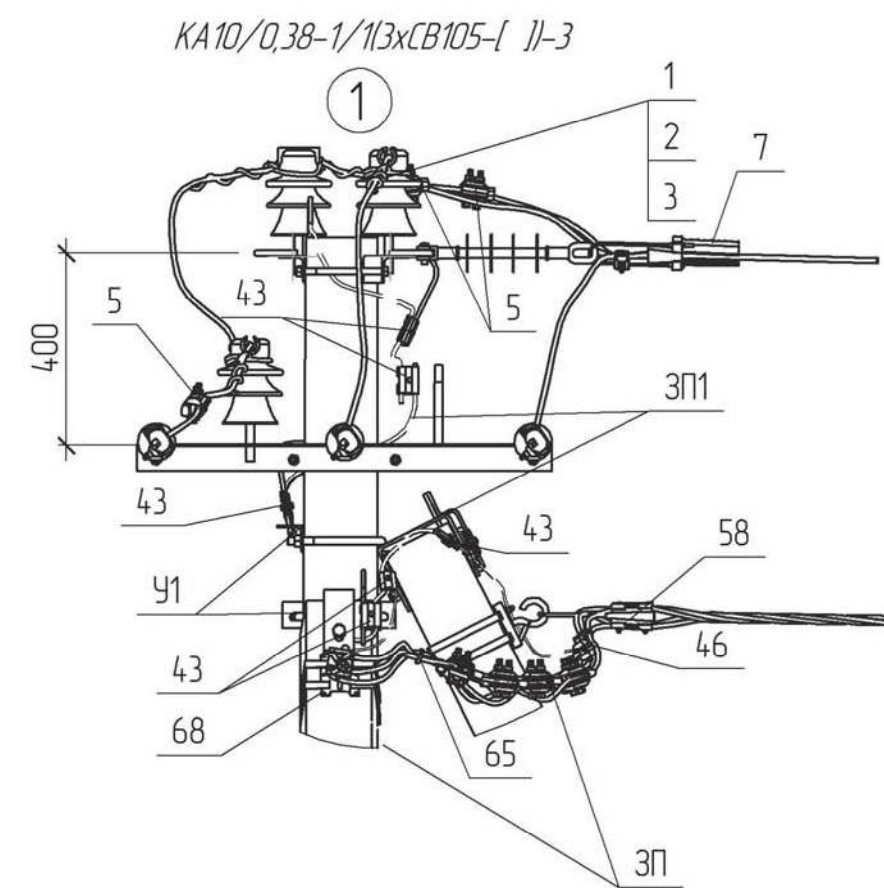


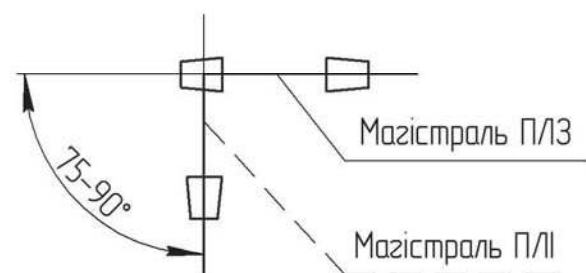


Technical drawing of a cable assembly, likely a power or signal cable, showing various components and connections. The drawing includes numbered callouts (1 through 7) pointing to specific parts:

- 1: Points to the top section of the cable assembly, possibly a connector or terminal block.
- 2: Points to a component on the right side of the top section.
- 3: Points to a component on the right side of the top section, below component 2.
- 4: Points to a component on the right side of the middle section.
- 5: Points to a component on the left side of the middle section.
- 6: Points to a component on the left side of the middle section, below component 5.
- 7: Points to a component on the left side of the middle section, below component 6.


The drawing also shows a central vertical component, possibly a cable or a connector, and a bottom section with additional components and connections. The overall structure suggests a complex cable assembly with multiple connection points and components.

*6 Опція Р означає, що натяжний затискач має антипрекінгову систему. Р додається до найменування затискача, якщо проектована лінія знаходиться в 3-5 районі за ступенем забруднення атмосфери СЗ згідно п. 1.9. ПУЕ:2006


KA10/0,38-1/2(3xCB105-[])-3

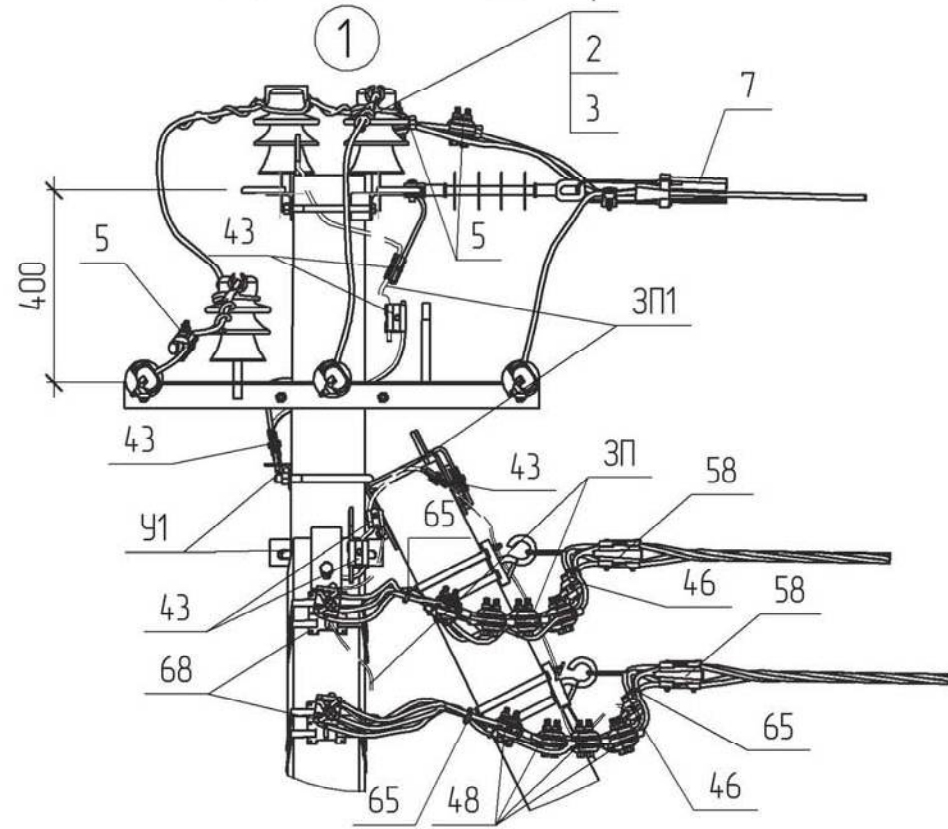

KA10/0,38-1/3(3xCB105-[])-3

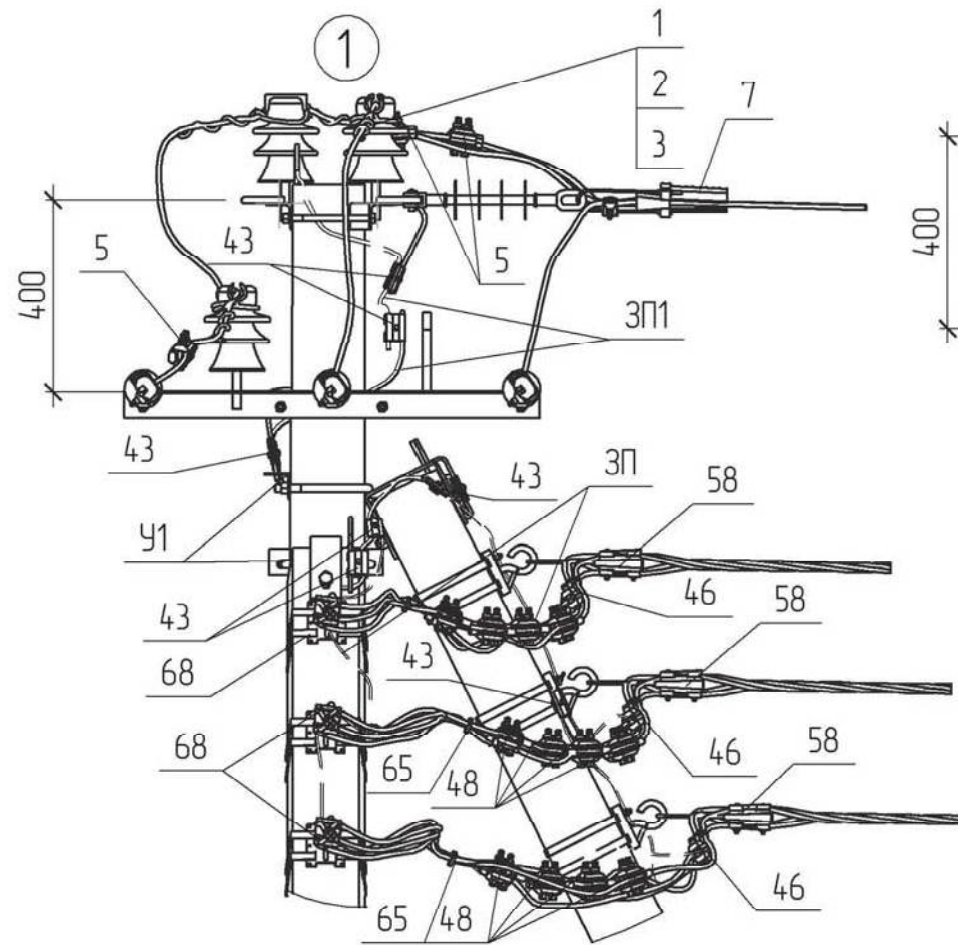

KA10/0,38-1/4(3xCB105-[])-3

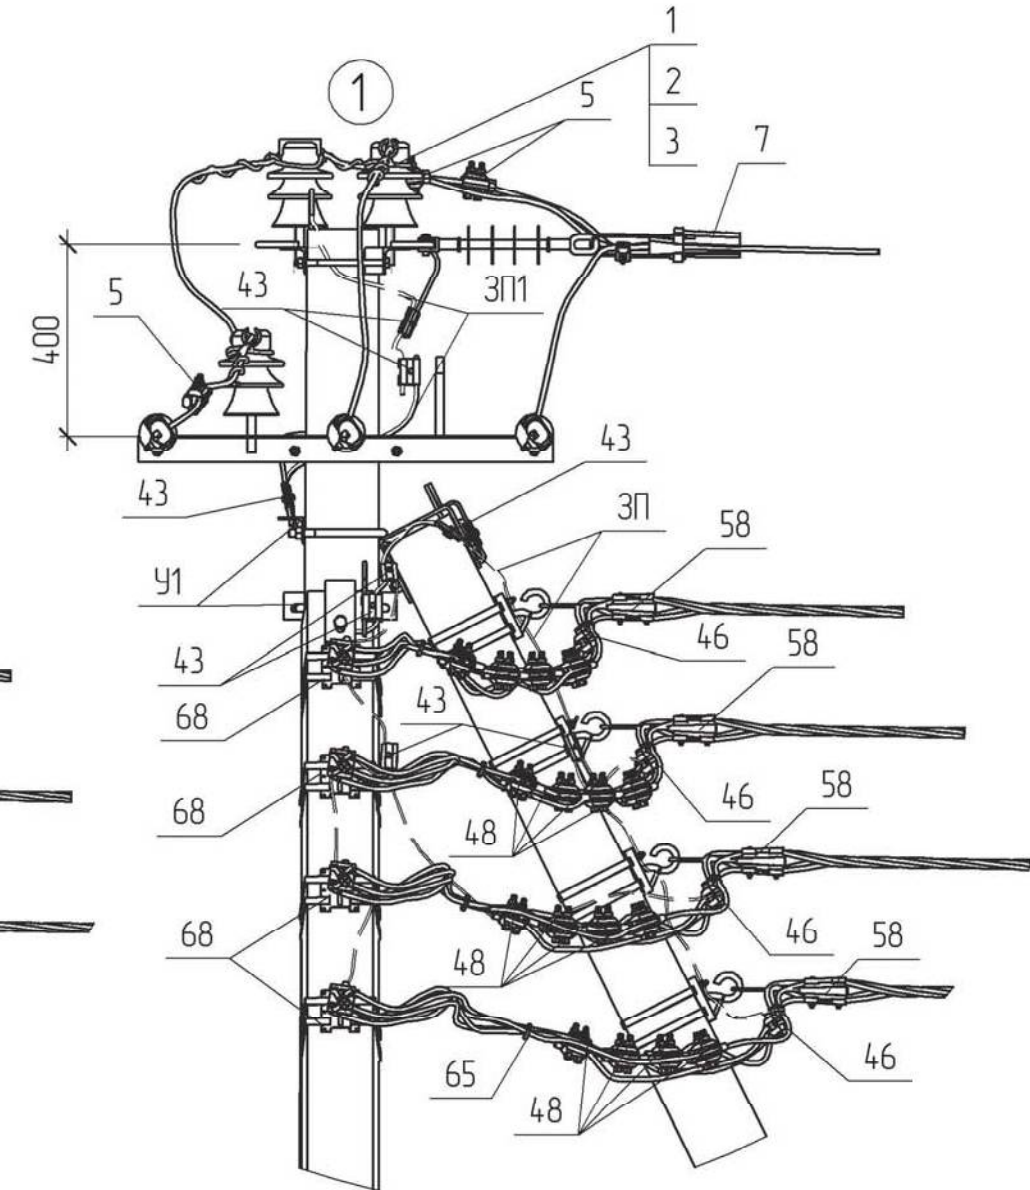


Інв. №	Зам. інв. №
оруж.	Підпис і дата

Зм.	Кільк.	Арк.	№ док.	Підпис	Дата

1.14/3-22

Арк.
2

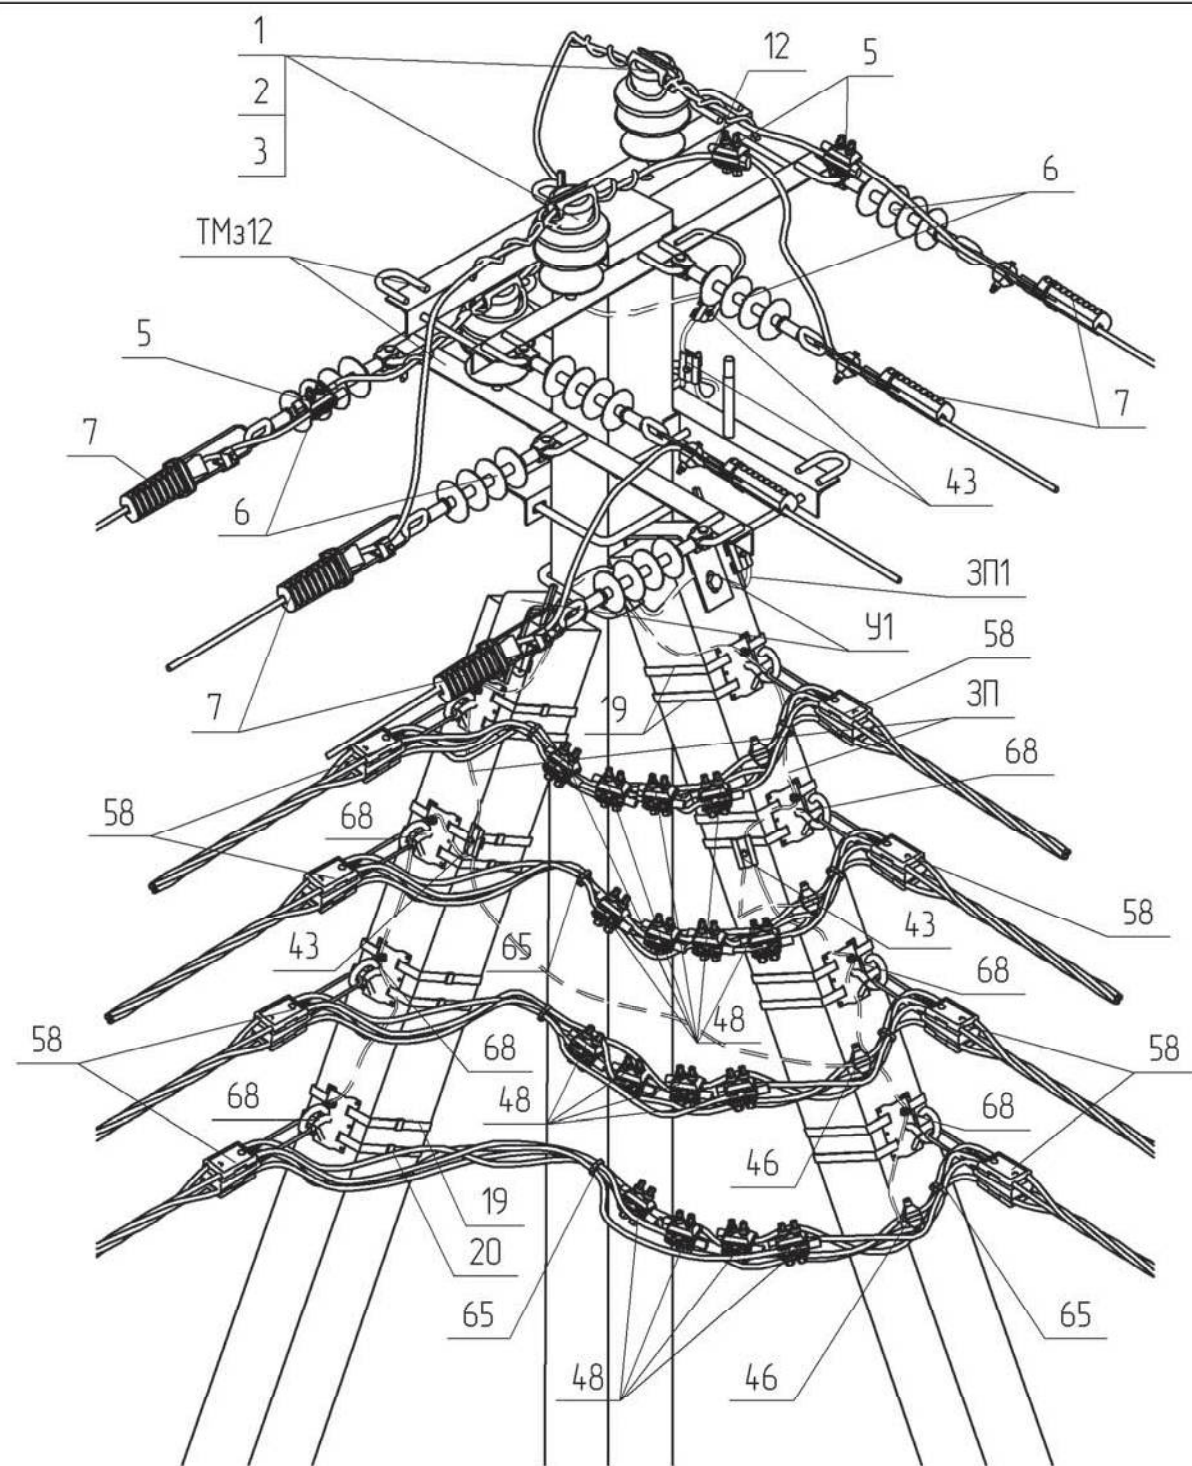

Зусилля, що діють на ґрунт в залежності від тяжіння T_{max} та кількості лінії П/Лі 0,38 кВ

Інв. №	оруд.	Підпис і дата	Зам. інв. №	Макси- мальне тяжіння П/Лі 6-10кВ, кН	Макси- мальне тяжіння П/Лі 0,38кВ, кН	Кількість кіл П/Лі 0,38кВ	Стискаюче зусилля на ґрунт N_p , кН
				2	2	0 1 2 3 4	26 31 37 42 48
4				4	2	0 1 2	44 50 55
						0 1 2	44 55 66

Поз.	Позначення	Найменування	Без лінії 0,38 кВ	Кількість кіл ПЛ 0,38 кВ				Маса од. кг	Примітка
				1	2	3	4		
		Залізобетонні елементи:							
СВ105-[]	ТУ.У.В.2.6.00113997.004-94	Стояк СВ105-[]	3	3	3	3	3	1180	
		Сталеві конструкції:							
ТМз12	180.2н./5-15	Траверса ТМз12	2	2	2	2	2	18.24	
У1	180.2н./5-1	Кронштейн У1	2	2	2	2	2	6.9	
19	SICAME	Бандажна стрічка IF 207, L=3 п.м.		2	4	6	8	0.36	
20	SICAME	Скріпа CF 20		4	8	12	16	0.01	
68	SICAME	Гак універсальний CSC 16uz		2	4	6	8	1.0	
ЗП	ГОСТ839-80	Провід А16, L=0.5 п.м.		4	6	8	10	0.03	
ЗП1		φ 10, ДСТУ 4738:2007, L=2.2 п.м.	1	1	1	1	1	1.36	
	Всього на опорі, кг								
		Лінійна арматура:							
1	ТУ У 26.2-00214652-003:2010	Ізолятор ШФ-20Г1	3	3	3	3	3	3.8	
2	ТУ 35-2036-90	Ковпачок К-6	3	3	3	3	3	0.03	
3 *1	SICAME	В'язка спіральна діелектрична PLCDT2	3	3	3	3	3	0.17	50-70 мм ²
		В'язка спіральна діелектрична PLCDT3						0.20	95-120 мм ²
5	SICAME	Затискач прокалюючий TTDC28401 FBA	3	3	3	3	3	0.39	50-120 мм ²
6	SICAME	Ізолятор натяжний PSI15CE	6	6	6	6	6	1.46	
7 *1	SICAME	Затискач натяжний PA2870 P *6	6	6	6	6	6	0.54	50-70 мм ²
		Затискач натяжний PA28120 P *6						0.82	95-120 мм ²
43	SICAME	Затискач плашковий PGA 101	5	7	8	9	10	0.055	
46*1	SICAME	Затискач для повторних заземлень TND 151		1	2	3	4	0.11	25-95 мм ²
		Затискач для повторних заземлень TND 241						0.17	120 мм ²
48*1	SICAME	Затискач прокалюючий магістральний TTD 301 GP		4	8	12	16	0.24	25-95 мм ²
		Затискач прокалюючий магістральний TTD 401 GP						0.39	120 мм ²
58*1	SICAME	Затискач натяжний магістральний GUKo1		2	4	6	8	0.8	25-50 мм ²
		Затискач натяжний магістральний GUKo2						1.23	70-120 мм ²
65	SICAME	Хомут CCD 9-62		2	4	6	8	0.04	
	Додаткове обладнання								