




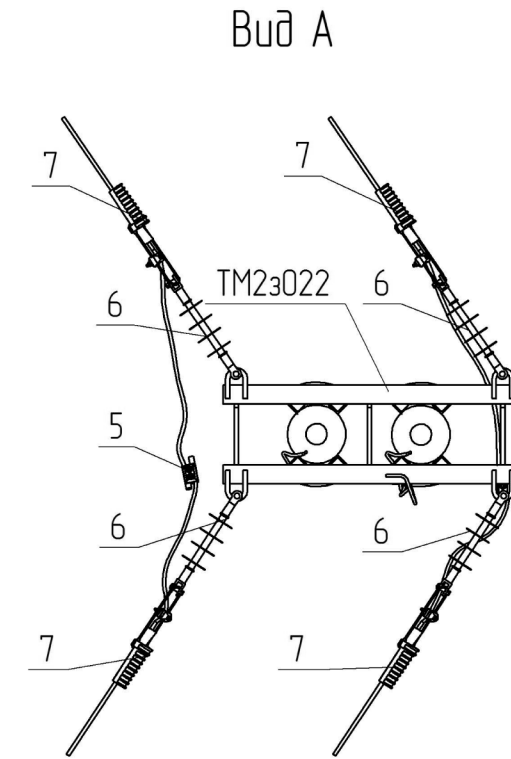


Схема встановлення опори

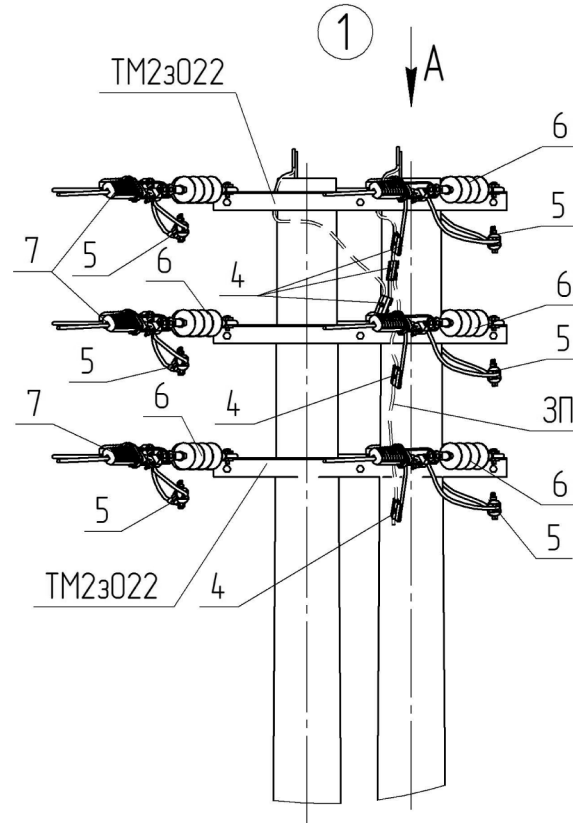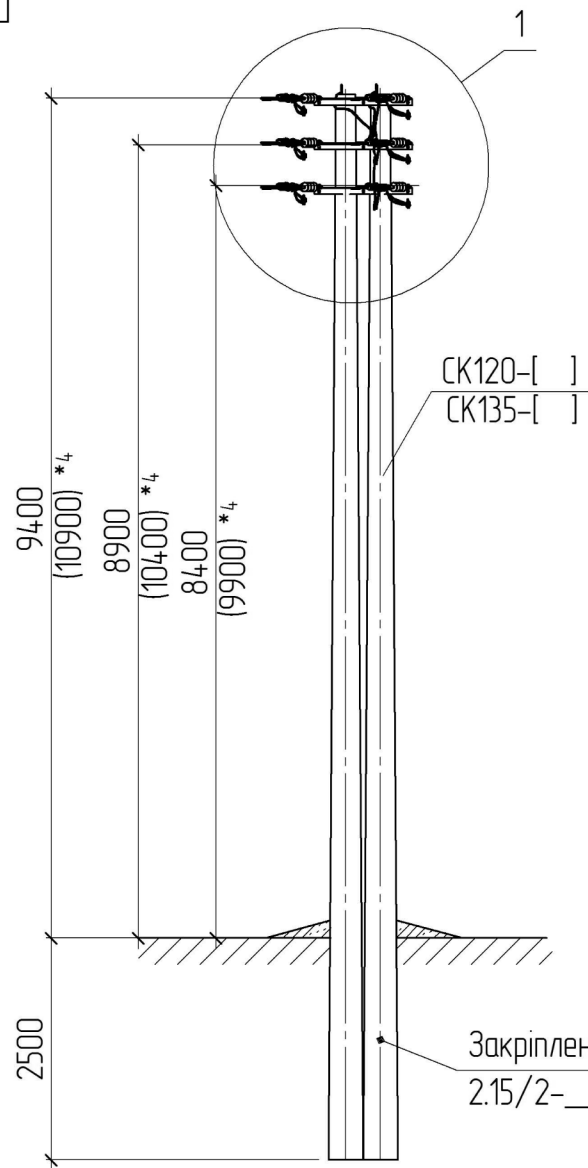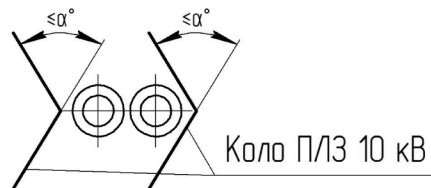

*1 Тип арматури залежить від перерізу проводу магістралі (див 2.15/5)

*4 Значення у дужках наведені для опори зі стояком СК135-[]

*6 Опція Р означає, що натяжний затискач має антітрекінгову систему.

Р додається до найменування затискача, якщо проектована лінія знаходиться в 3-5 районі за ступенем забруднення атмосфери СЗ

Прив'язаний	Зм.	Кільк.	Арк.	№ док.	Підпис	Дата
	ГІП		Журавльов		<i>[Signature]</i>	1.05
	Н.контр.		Блінов		<i>[Signature]</i>	3.02
	Перевір.		Меркотан		<i>[Signature]</i>	2.03
	Розроб.		Іщук		<i>[Signature]</i>	4.03
Інв. №						

2.15/3-05

Кутова анкерна опора
КА10-2з(2хСК120-[])-1
КА10-2з(2хСК135-[])-1

Стадія	Аркцш	Аркцшів
РП	1	2
НВП ТОВ „ЕНЕРГОЛІГА“		

Technical drawing of a cable tray assembly. The drawing shows a vertical support structure with multiple horizontal cable trays. The trays are labeled with the number 7. The assembly includes various components, including cables, connectors, and mounting hardware, which are labeled with the numbers 4, 5, and 6. The label TM23022 is also present, indicating a specific part or model.

№. № ориз.	Підпис і дата	Зам. інв. №